


# Model 1011A TESTANDRAIN®

**Sectional Floor Control Test and Drain Valve for Systems Requiring Pressure Relief Valve** 

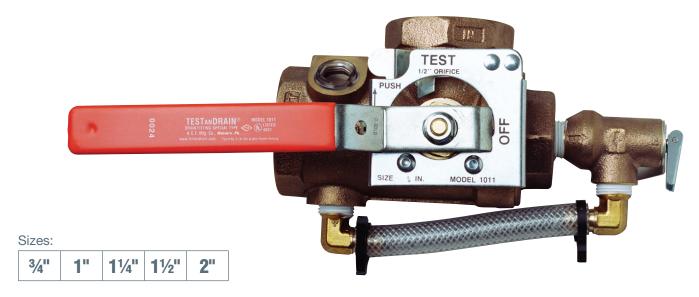

The AGF **Model 1011A TESTANDRAIN**® provides the test and express drain functions for wet fire sprinkler systems on multi-story installations requiring pressure relief (NFPA 13 and NFPA 13R). The **Model 1011A** features a **Model 7000 Pressure Relief Valve** with drain pipe.

The **Model 1011A** is available in a full range of sizes (¾" to 2") with NPT connections (BSPT available). The **Model 7000 Pressure Relief Valve** (UL/FM) features a flushing handle and a 175 PSI factory rating (other pressure ratings available).

- Complies with NFPA 13 and NFPA 13R Requirements
- Compact, Single-Handle Ball Valve
- Tamper-Resistant Test Orifice and Sight Glasses
- 300 PSI rated.
- Specifiable orifice sizes: 3/8" (2.8K), 7/16" (4.2K), 1/2" (5.6K), 17/32" (8.0K), 5/8" (11.2K, ELO), 3/4" (14.0K, ESFR), and K25
- Relieves Excess System Pressure caused by Surges or Temperature Changes
- Shipped with Relief Valve and Bypass Drain Ports Plugged to Expedite Pressure Testing
- Locking Kit Available

Repair kits are available for all **TESTANDRAIN**® valves. Kit includes: Adapter Gasket (1), Ball (1), Valve Seats (2), Stem Packing (1), and Stem Washer (1). *Valve and orifice size must be specified when ordering.* 

NOTE: It is important to note that the pressure rating of the relief valve indicates an operating range of pressure for both opening and closing of the valve. Standard relief valves are required to OPEN in a range of pressure between 90% and 105% of their rating. The valves are required to CLOSE at a pressure above 80% of that rating. The relief valve should be installed where it is easily accessible for maintenance. Care should be taken that the relief valve CANNOT be isolated from the system when the system is operational. A relief valve should NEVER have a shutoff valve or a plug downstream of its outlet.





## Model 1011A TESTAN DRAIN®

Model 1011A 300 PSI Bronze Ball Valve, Model 7000 Pressure Relief Valve Factory Rated at 175 PSI with other setting available

### **Dimensions**

SIZE	Α	В	С	D	Е	F	G	Н
3/4"	79/16"	1½"	<b>2</b> 3/16"	35/8"	33/8"	113/16"	<b>4</b> 9/16"	63/8"
	(191 mm)	(37.5 mm)	(57 mm)	(93 mm)	(86 mm)	(46 mm)	(117 mm)	(162.5 mm)
1"	79/16"	11/2"	23/16"	35/8"	33/8"	113/16"	<b>4</b> 9/16"	63/8"
	(191 mm)	(37.5 mm)	(57 mm)	(93 mm)	(86 mm)	(46 mm)	(117 mm)	(162.5 mm)
11/4"	715/16"	<b>1</b> 11/16"	<b>2</b> 9/16"	41/4"	35/8"	<b>1</b> 15/16"	59/16"	71/2"
	(201 mm)	(43 mm)	(65 mm)	(108 mm)	(91 mm)	(51 mm)	(141 mm)	(192 mm)
1½"	8 <sup>15</sup> /16"	<b>1</b> 13/16"	31/4"	5½16"	37/8"	25/8"	81/4"	107/8"
	(227 mm)	(45 mm)	(81.5 mm)	(127 mm)	(99 mm)	(67 mm)	(207 mm)	(274 mm)
2"	8 <sup>15</sup> / <sub>16</sub> "	113/16"	31/4"	5½16"	37/8"	25/8"	81/4"	107/8"
	(227 mm)	(45 mm)	(81.5 mm)	(127 mm)	(99 mm)	(67 mm)	(207 mm)	(274 mm)

### The Model 1011A provides the following...

From the 2013 Edition of NFPA 13

Chapter 8.16.2.4.1\* Provisions shall be made to properly drain all parts of the system. Chapter 8.16.2.4.2 Drain connections, interior sectional or floor control valve(s) –

& 8.16.2.4.3 shall be provided with a drain connection having a minimum size as shown in Table 8.16.2.4.2.

Chapter 8.16.2.4.4 Drains shall discharge outside or to a drain capable of handling the

Chapter A.8.17.4.2 (Wet Pipe System) test connection is permitted to terminate into a drain capable of accepting full flow... using an approved sight test

drain capable of accepting full flow... using an approved sight test connection containing a smooth bore corrosion-resistant orifice giving a flow equivalent to one sprinkler...

Chapter 8.17.4.2.2 The test connection valve shall be accessible.

Chapter 8.17.4.2.4 shall be permitted to be installed in any location... downstream of

the waterflow alarm.

Chapter 8.17.4.3.1 (Dry Pipe System) a trip test connection not less than 1" in

diameter, terminating in a smooth bore corrosion-resistant orifice,

to provide a flow equivalent to one sprinkler...

Chapter 8.17.4.3.2 The trip test connection... with a shutoff valve and plug not less

than 1", at least one of which shall be brass.

Chapter 7.1.2 - a wet pipe system shall be provided with a listed relief valve set

to operate at 175 PSI or 10 PSI in excess of the maximum system

pressure, whichever is greater.

Chapter 8.16.1.2.3\* A listed relief valve of not less than ½" in size shall be provided on


the discharge side of the pressure-reducing valve set to operate at

a pressure not exceeding rated pressure of the system.


Chapter A.8.16.1.2.3 - consideration should be given to piping the discharge from the

(pressure relief) valve

### Model 1011A - Front View



### Model 1011A - Plan View



### **Orifice Sizes**

3/8", 7/16", 1/2", 17/32", 5/8" ELO\*, 3/4" ESFR\*, and K25\*\*

### **Materials**

Handle	Steel
Stem	Rod Brass
Ball	C.P. Brass
Body	Bronze
Valve Seat	Impregnated Teflon®
Indicator Plate	Steel
Relief Valve	Bronze
Bypass Fittings	Brass
Bypass Tubing	Nylobraid

### **Approvals**

UL and ULC Listed: (EX4019 & EX4533) FM Approved NYC-BSA No. 720-87-SM



### **USA Patent # 4741361 and Other Patents Pending**



## AGF Manufacturing Inc.

100 Quaker Lane, Malvern, PA 19355

Phone: 610-240-4900 Fax: 610-240-4906

www.testandrain.com

Job Name:	
Architect:	
Engineer:	
Contractor:	